

TOYOTA

SERVICE BULLETIN

TOYOTA MOTOR SALES, U.S.A., INC.

VOLUME

10

HEATING & AIR
CONDITIONING

REFERENCE _____

NUMBER 007

DATE 09-29-89


MODEL ALL MODELS

Page 1 of 1


EVACUATION OF AIR CONDITIONING REFRIGERATION SYSTEMS

The air conditioning refrigerant evacuation procedure has been revised to reduce evacuation time and minimize the release of CFC gas into the atmosphere. Please follow this new procedure for all Toyota vehicles.

PREVIOUS PROCEDURE

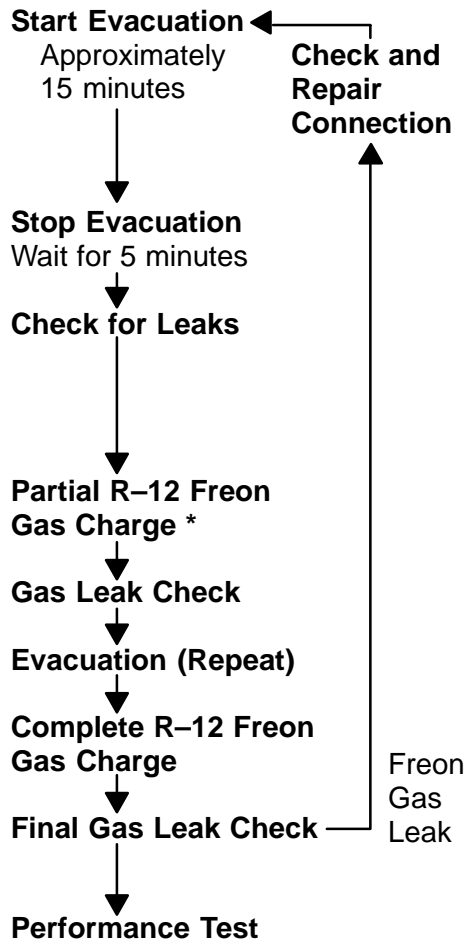

NEW PROCEDURE

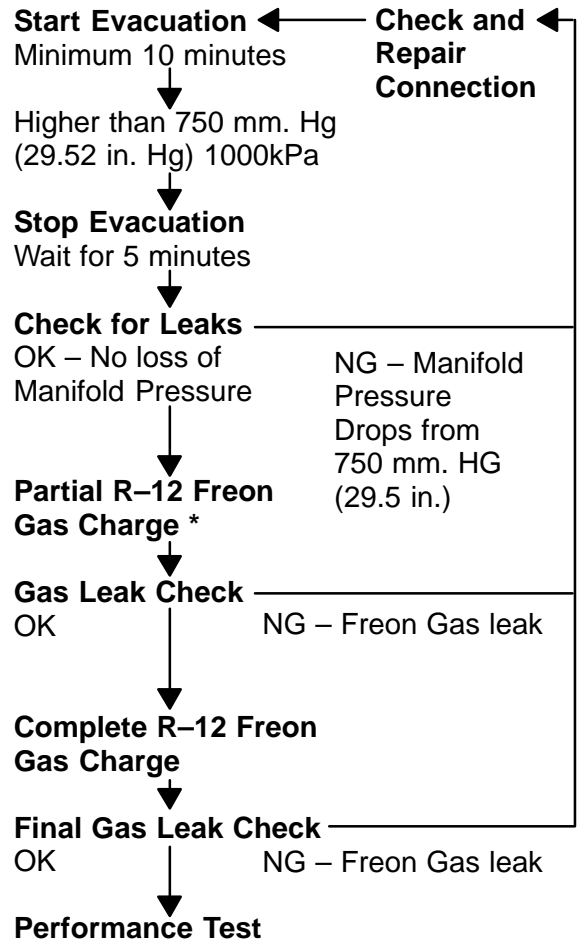

* Charge Freon gas until the low pressure gauge reaches 1 kg/cm².